

NOTES:

1. ROD 8" GATE VALVES TO TEES. CLOSE 8" GATE VALVES & REMOVED VALVE BOX AND FILL W/SAND. CAP 8W (2 EACH).



PROJECT

Water System Improvements For Charleston Water System
 Armstrong Tract Transmission Main Improvements




CLIENT

CHARLESTON WATER SYSTEM

103 St. Philip Street
 Charleston, South Carolina
 843.727.6880 tel 843.727.0017 fax
 www.charlestonwater.com


CONSULTANT

AECOM
 4016 Salt Pointe Pkwy
 N. Charleston, South Carolina
 843.767.4602 tel 843.767.4723 fax
 www.aecom.com

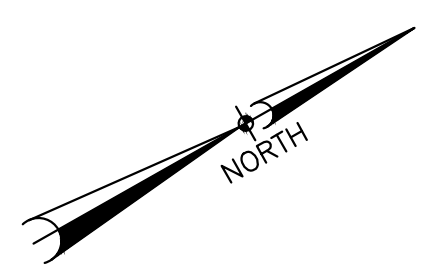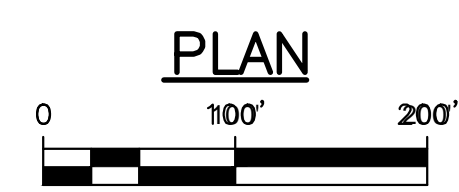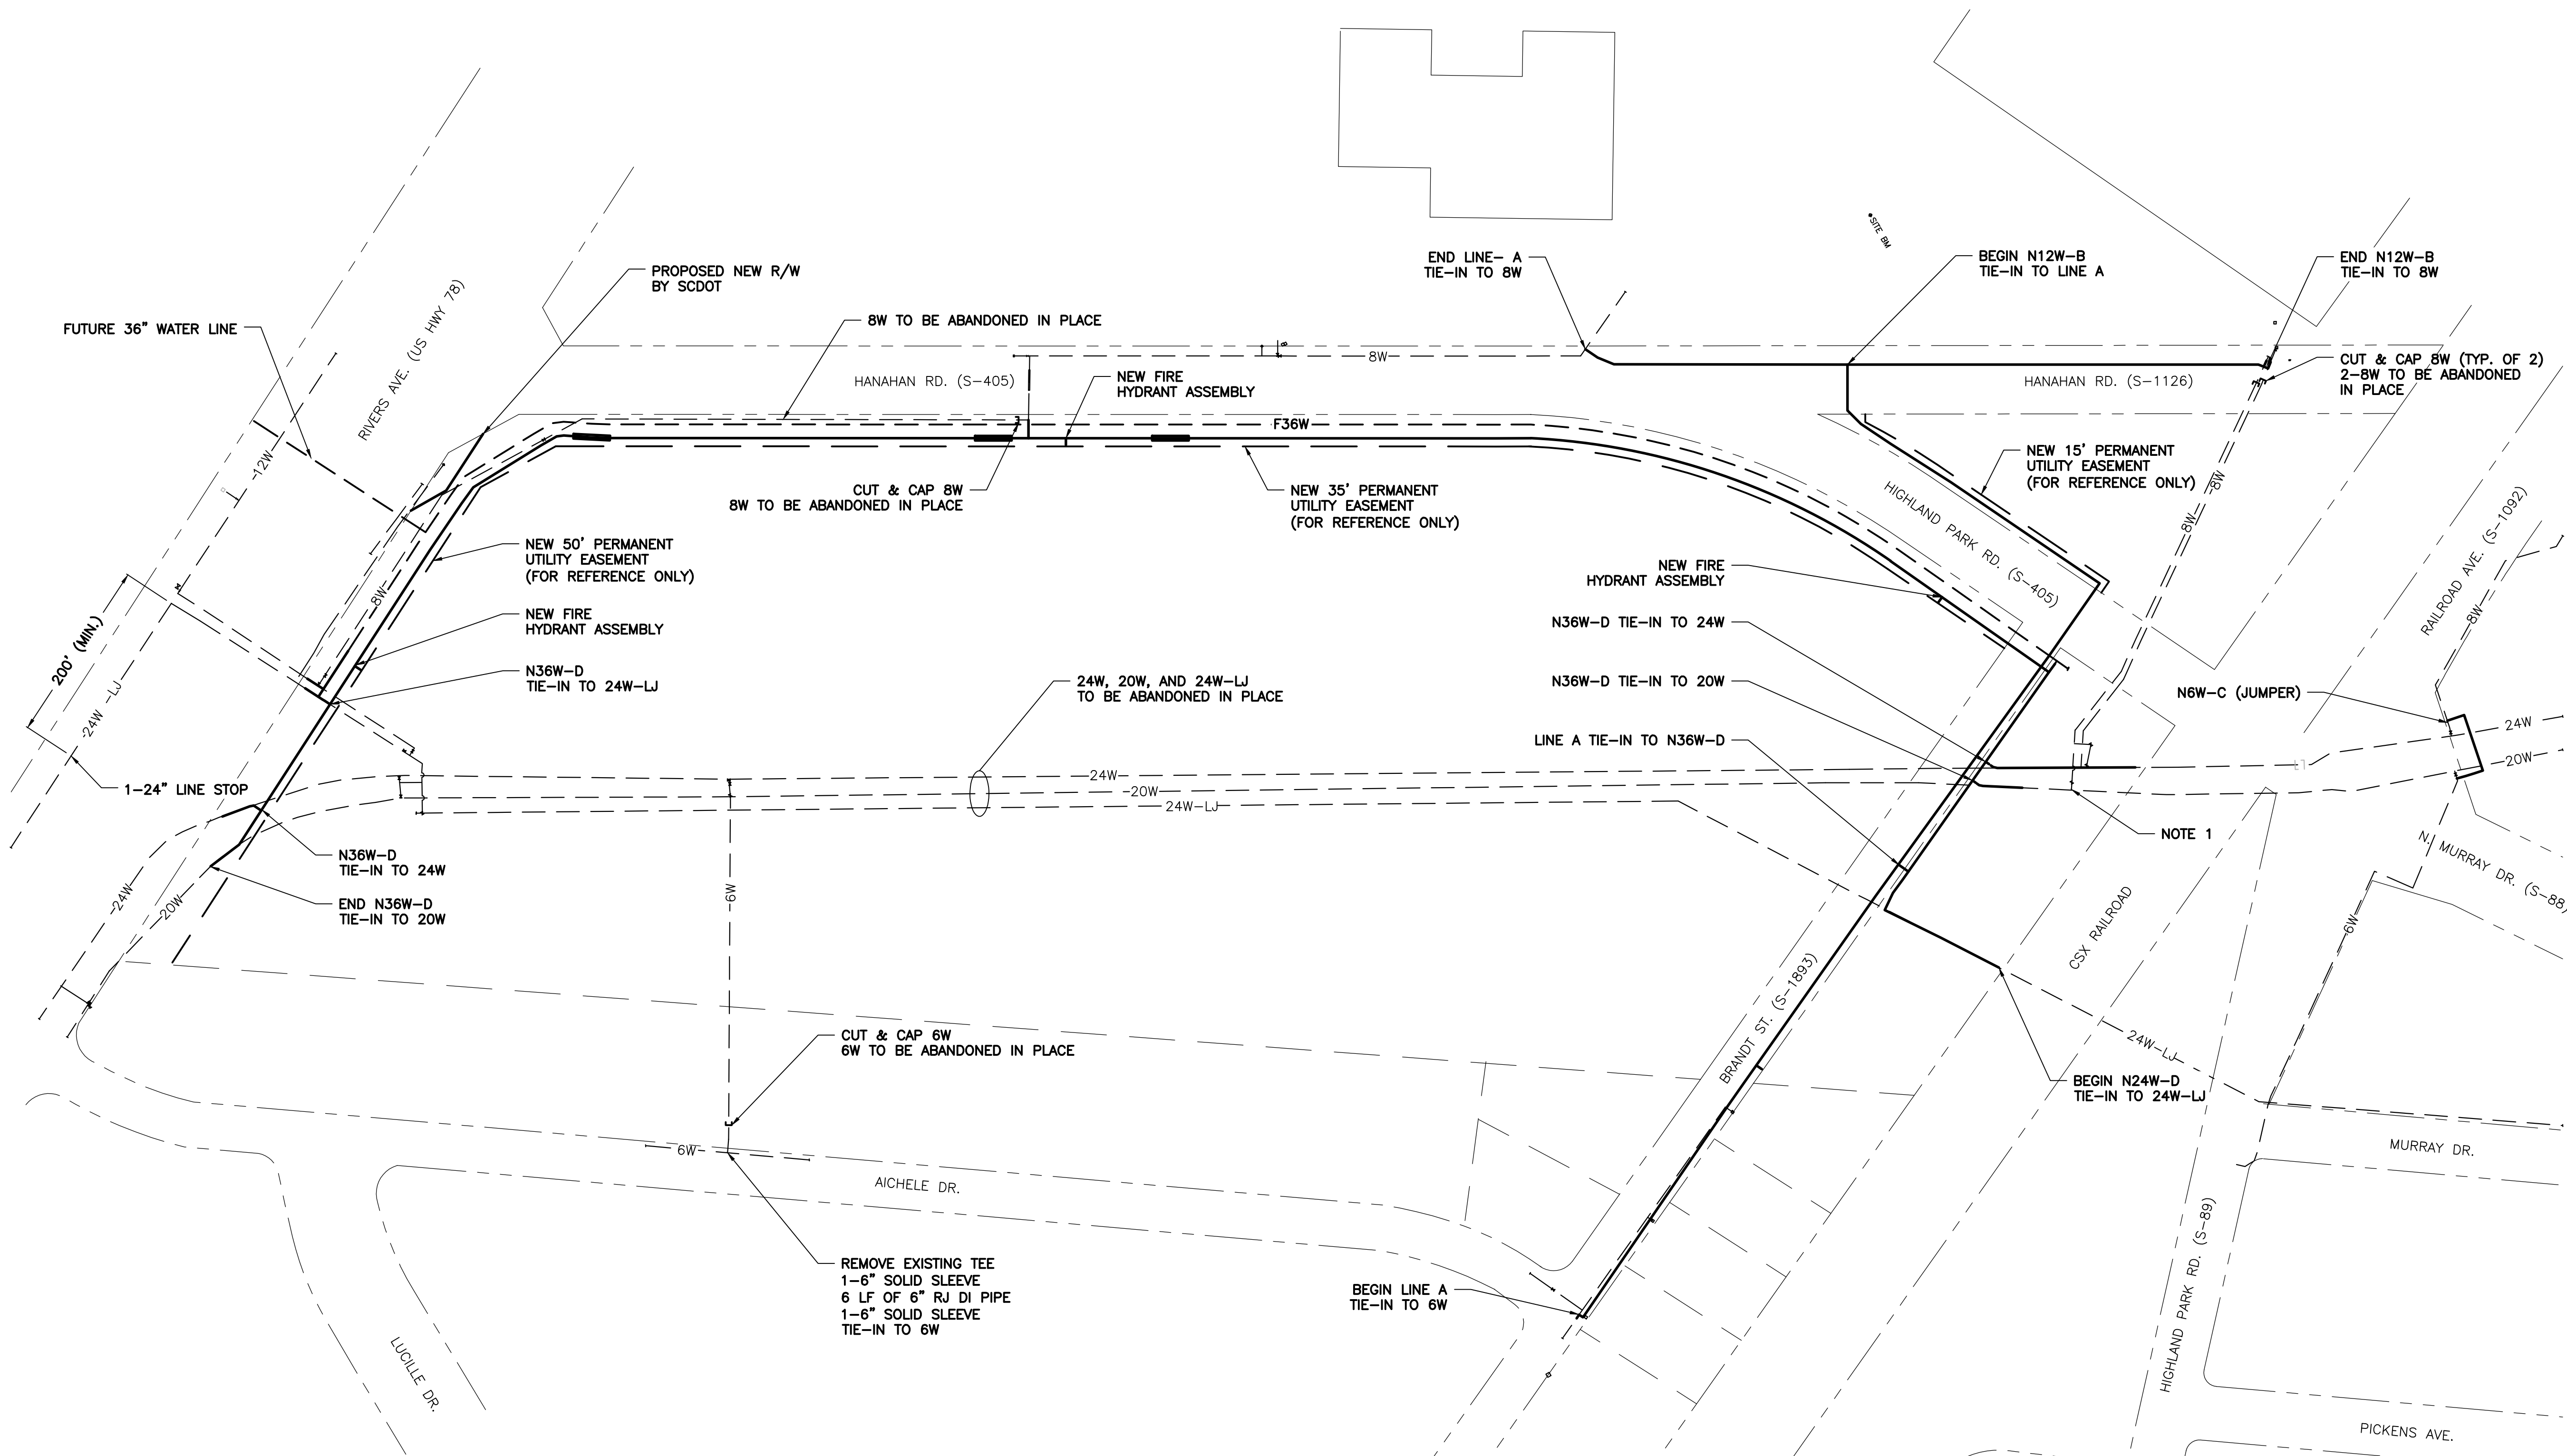

FOR AGENCY REVIEW
 THESE DOCUMENTS ARE PRELIMINARY AND ARE NOT FOR USE FOR CONSTRUCTION

REGISTRATION

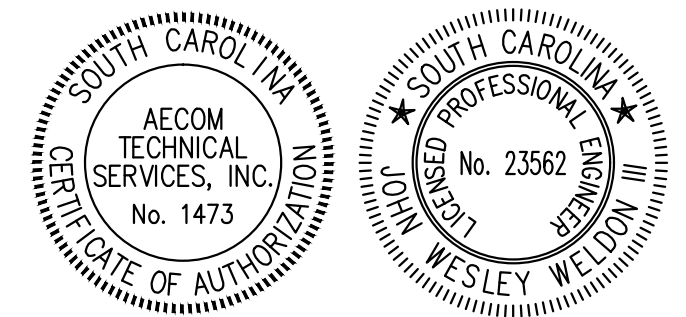

ISSUE/REVISION

I/R	DATE	DESCRIPTION

KEY PLAN

PROJECT NUMBER

60427189

SHEET TITLE

OVERALL PROJECT LAYOUT

SHEET NUMBER

C1