


TYPICALLY CLASS III BACKFILL. USE CLASS II BACKFILL WHERE UNSUITABLE TRENCH MATERIAL IS ENCOUNTERED OR AS DIRECTED BY THE ENGINEER.

PIPE ZONE CLASS II BACKFILL 6" LIFTS

UNDISTURBED SOIL

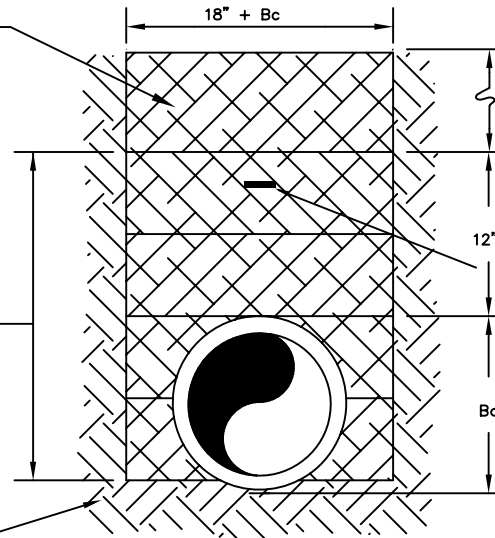


DEPTH VARIES

12"

MAGNETICALLY DETECTABLE TAPE  
18" - 24" BELOW GRADE  
USE FOR ALL TYPES OF PIPE

Bc

NOTE: REFER TO HIGHWAY DEPARTMENT, CITY, OR COUNTY PERMITS FOR ADDITIONAL REQUIREMENTS.

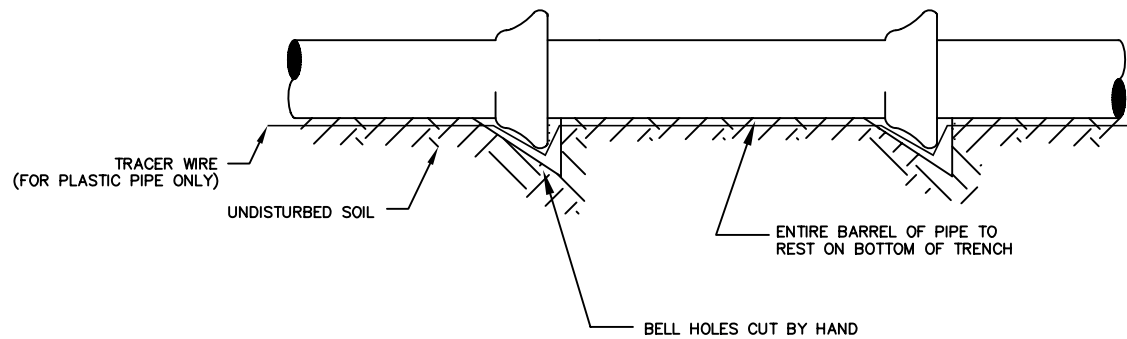

### WATER MAIN BEDDING

CHARLESTON COMMISSIONERS  
OF PUBLIC WORKS

### WATER MAIN BEDDING

APPROVED BY:  
CPW  
SCALE:  
NTS

DATE:  
MAR 2000  
REVISED:  
NOV 2007

DRAWING NO.  
1