


NOTE:

THICKNESS OF CONCRETE PATCH SHALL BE AS SPECIFIED IN SCDOT PERMIT REQUIREMENTS. MINIMUM 6" OF 3500 PSI CONCRETE AND 4" SABC COMPACTED BASE AS PER PERMIT REQUIREMENTS

NOTE:

THICKNESS OF ASPHALT PATCH SHALL BE AS SPECIFIED IN SCDOT PERMIT REQUIREMENTS. MINIMUM 1 1/2" COMPACTED ASPHALT

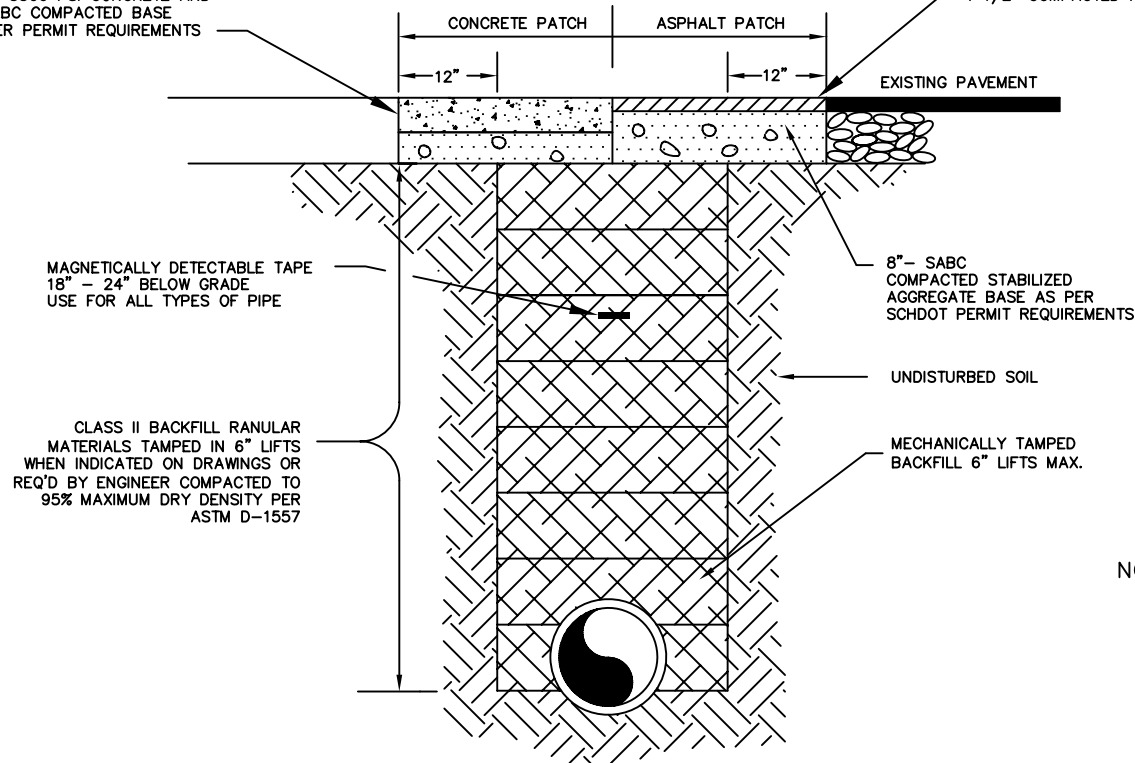

MAGNETICALLY DETECTABLE TAPE 18" - 24" BELOW GRADE USE FOR ALL TYPES OF PIPE

CLASS II BACKFILL GRANULAR MATERIALS TAMPED IN 6" LIFTS WHEN INDICATED ON DRAWINGS OR REQ'D BY ENGINEER COMPACTED TO 95% MAXIMUM DRY DENSITY PER ASTM D-1557

8" - SABC COMPACTED STABILIZED AGGREGATE BASE AS PER SCDOT PERMIT REQUIREMENTS

UNDISTURBED SOIL

MECHANICALLY TAMPED BACKFILL 6" LIFTS MAX.

NOTE: REFER TO HIGHWAY DEPARTMENT, CITY, OR COUNTY PERMIT FOR ADDITIONAL REQUIREMENTS.

MAIN UNDER PAVED DRIVEWAY

CHARLESTON COMMISSIONERS OF PUBLIC WORKS

MAIN UNDER PAVED DRIVEWAY

APPROVED BY:
CPW
NTS

DATE:
MAR 2000
REVISED:
NOV 2007

DRAWING NO.
3