


NOTES:

1. MAINS GREATER THAN 8" SHALL USE A FIRE HYDRANT FOR A BLOWOFF.
2. BLOWOFF MATERIAL SHALL BE 2" FOR A 6" MAIN AND 3" FOR AN 8" MAIN.

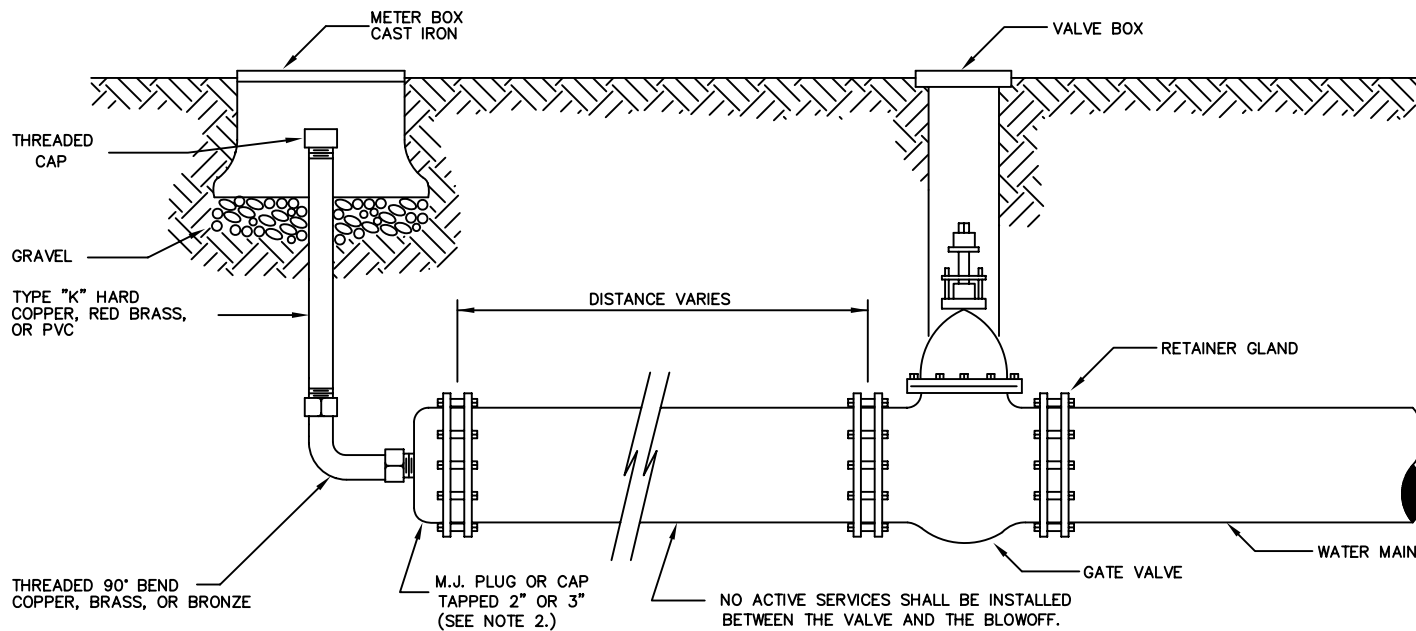

TEMPORARY BLOWOFF  
FOR 6" AND 8" MAINS  
(FOR MAINS TO BE EXTENDED LATER)

CHARLESTON COMMISSIONERS  
OF PUBLIC WORKS

TEMPORARY BLOWOFF  
FOR 6" AND 8" MAINS

APPROVED BY: CPW	DATE: MAY 2002	DRAWING NO.  15
SCALE: NTS	REVISED: MAR 2009	