


- NOTES:**
1. Contractor will provide all material and install services under CWS supervision.
 2. All taps will be made in accordance with CWS Minimum Standardss and AWWA guidelines for tapping through polyethylene encasement.
 3. All meter boxes shall be installed perpendicularly to the property line, as shown herein.

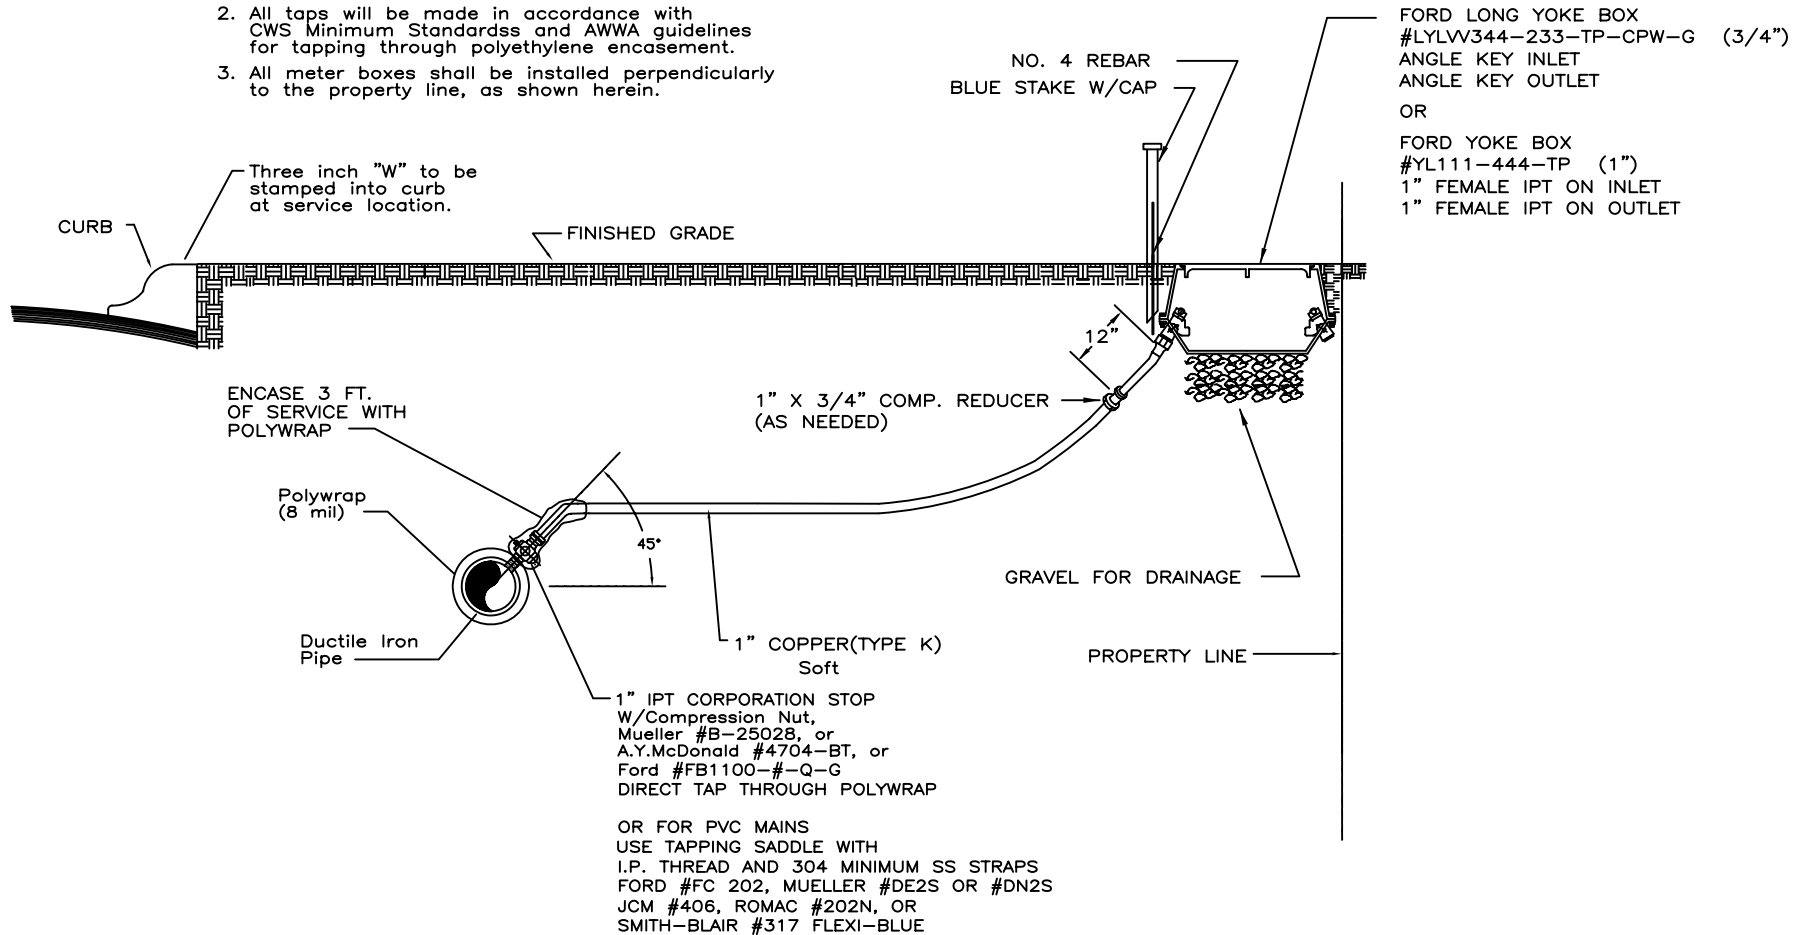

3/4" - 1" SINGLE WATER SERVICE NEAR SIDE

CHARLESTON COMMISSIONERS OF PUBLIC WORKS

3/4" - 1" SINGLE WATER SERVICE NEAR SIDE

APPROVED BY: CPW	DATE: MAR 2003	DRAWING NO. 19
SCALE: NTS	REVISED: NOV 2007	