


WYE PLAN VIEW

- NOTES:
1. Contractor will provide all material and install services under CPW supervision and developer's engineering inspector.
 2. All taps will be made in accordance with CPW specifications and AWWA guidelines for tapping through polyethylene encasement

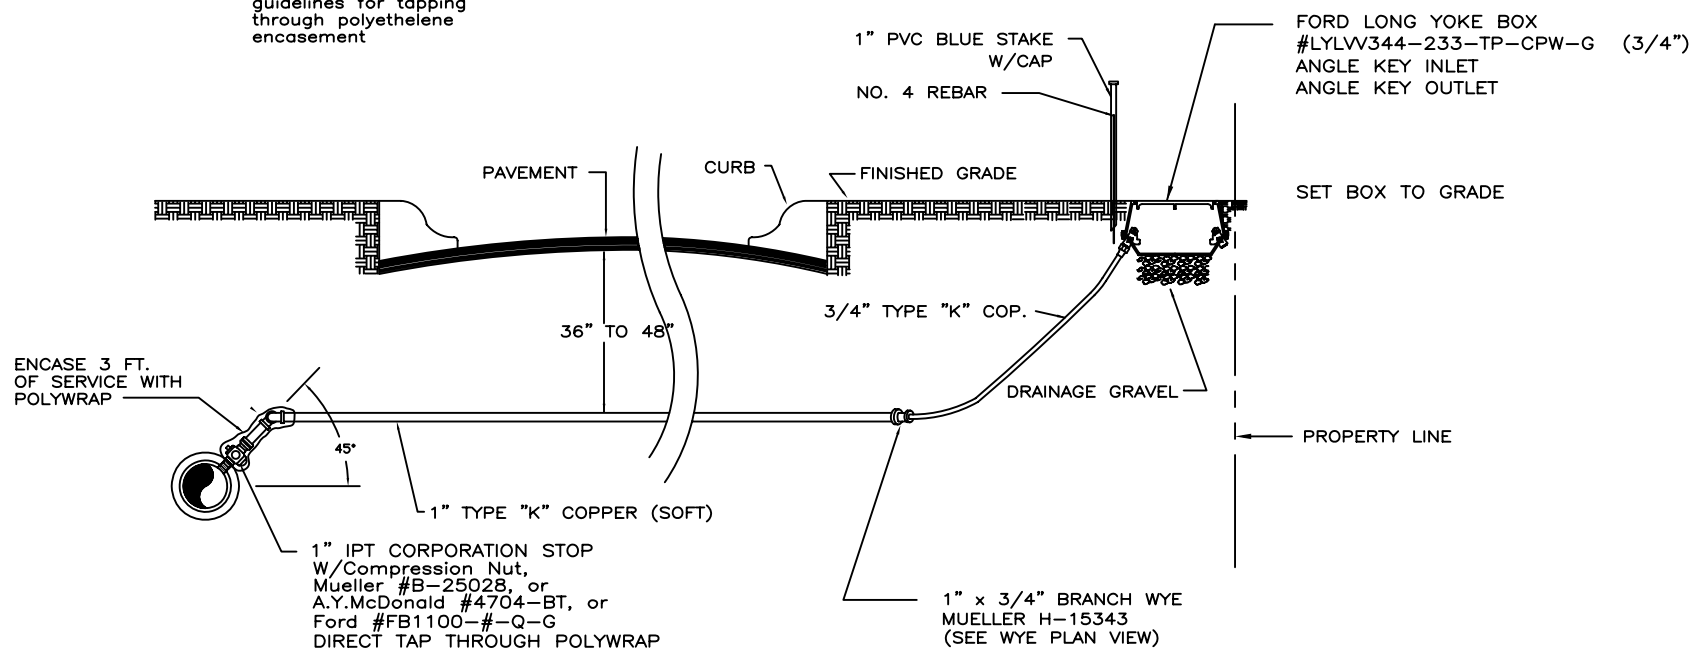

1" IPT CORPORATION STOP W/Compression Nut, Mueller #B-25028, or A.Y.McDonald #4704-BT, or Ford #FB1100-#-Q-G DIRECT TAP THROUGH POLYWRAP

OR FOR PVC MAINS USE TAPPING SADDLE WITH I.P. THREAD AND 304 MINIMUM SS STRAPS MUELLER #DE2S OR DN2S, FORD #FC202, JCM #406, ROMAC #202N, OR SMITH-BLAIR #317 FLEXI-BLUE

TYPICAL DOUBLE WATER SERVICE
(ONLY FOR APARTMENTS, CONDOMINIUMS, AND TRAILER PARKS)

CHARLESTON COMMISSIONERS OF PUBLIC WORKS		
TYPICAL DOUBLE WATER SERVICE		
APPROVED BY: CPW	DATE: DEC 2002	DRAWING NO. 22
SCALE: NTS	REVISED: NOV 2007	