


- NOTES:**
1. ONLY DOUBLE CHECKS VALVE ASSEMBLIES 2" AND SMALLER MAY BE INSTALLED BELOW GROUND AS SHOWN. ALL REDUCED PRESSURE PRINCIPLE ASSEMBLIES AND DOUBLE CHECK VALVE ASSEMBLIES LARGER THAN 2" MUST BE INSTALLED ABOVE GROUND.
 2. BOX MUST BE SIZED TO ALLOW ADEQUATE ROOM FOR TESTING AND MAINTENANCE. TYPICALLY THIS DIMENSION SHOULD BE A MIN. OF 6" ALL AROUND (SIDES AND BOTTOM).

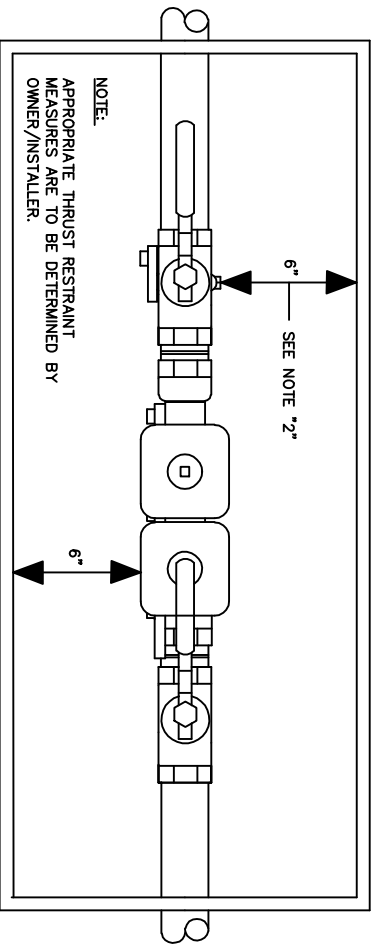

TYPICAL 2" AND SMALLER DOUBLE CHECK VALVE ASSEMBLY ONLY
 BACKFLOW PREVENTION ASSEMBLY
 BELOW GROUND INSTALLATION

CHARLESTON COMMISSIONERS
 OF PUBLIC WORKS

DOUBLE CHECK VALVE ASSEMBLY

APPROVED BY:	DATE:	DRAWING NO.:
CPW	MAR 2000	31
SCALE:	REVISED:	
NTS	NOV 2011	