


PLAN

NOTES:

1. EMBEDMENT SAME AS FOR SEWER MAIN.
2. SERVICE LINE SHALL BE ON SUCH A GRADE THAT WILL PERMIT SERVICING OF PROPERTY. MINIMUM GRADE SHALL BE 1.0%. MAXIMUM GRADE SHALL BE 50%.
3. NO VERTICAL STACKING SHALL BE ALLOWED.
4. FOR CLEANOUT INFORMATION REFER TO THE "SERVICE CONNECTION AND CLEANOUT" DETAIL.

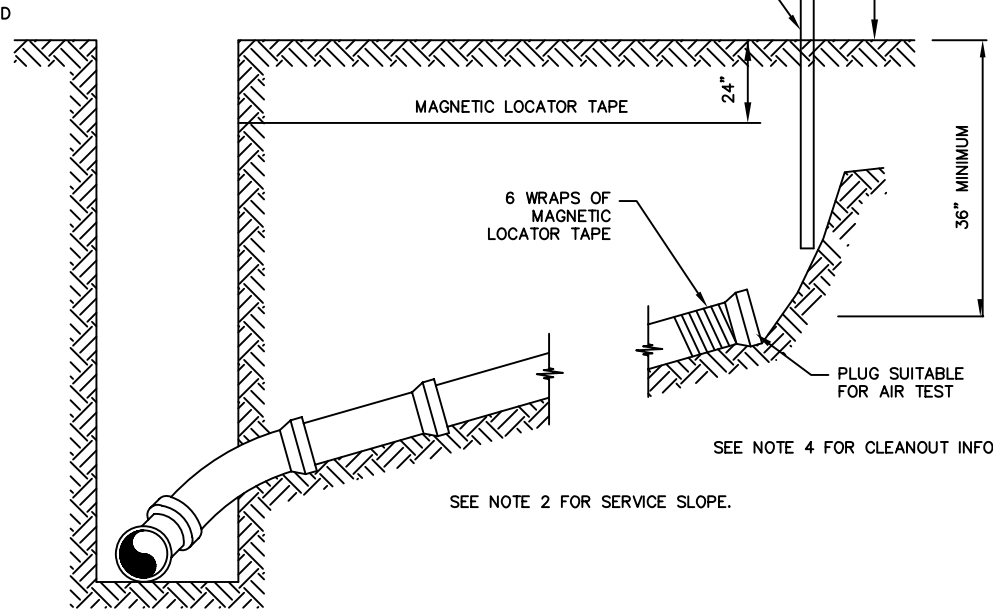

SEE NOTE 2 FOR SERVICE SLOPE.

SEE NOTE 4 FOR CLEANOUT INFORMATION.

SECTION

SEWER SERVICE CONNECTION TO MAIN

| | | |
|----------------------------------|----------------------|-----------------------|
| CHARLESTON WATER SYSTEM | | |
| SEWER SERVICE CONNECTION TO MAIN | | |
| APPROVED BY: CWS | DATE: MAR 2000 | DRAWING NO. 56 |
| SCALE: NTS | REVISED: FEB 2010 | |